


UNDERGROUND PLUMBING

These burial depths apply *outside of buildings* within private property subject to the following provisions:

- Not applicable to San Diego Gas and Electric Company's gas and utility lines
- Pipe may not be in the same trench without horizontal separation except as noted for sewer and water lines
- Not applicable to mobile home parks
- Requirements based on the 2007 California Plumbing Code (CPC)

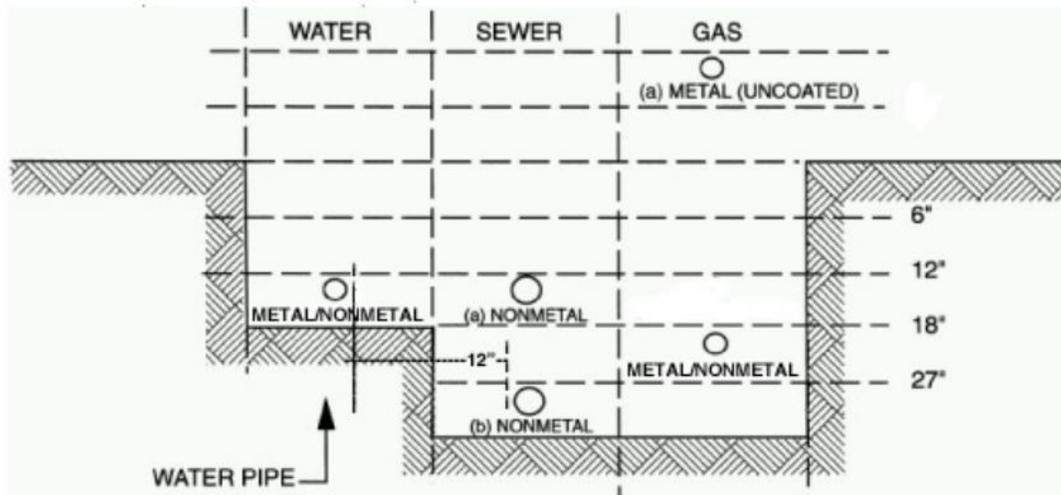

METAL -
& NONMETAL - 12" minimum

SEWER PIPE

METAL - No burial requirement

NONMETAL - (a) 12" minimum below grade

(b) If sewer piping materials are the type not approved for use within or under a building and a single trench is desired for both water and waste systems, then the water piping must be shelved to one side of the trench and installed a minimum of 12" above the sewer.

GAS PIPE

METAL - 18" below ground (factory coated or machine wrapped).

NONMETAL - 18" minimum

NOTE: Approved plastic to metal transition fittings required (all plastic pipe to be a minimum of 18" below ground). Also 18 GA. yellow insulated copper tracer wire required.

UNDERGROUND CSST TO BE INSTALLED PER MANUFACTURER'S LISTING

Building Division Counter is open between the hours of 7:30 a.m. and 5:30 p.m. (closed for lunch 11:30 a.m. - 12:30 p.m.) Monday through Thursday. City Hall and the Building Division counter are closed on alternating Fridays ([see calendar](#)). Our Friday hours are 8:00 a.m. – 5:00 p.m. (closed for lunch 11:30 a.m. - 12:30 p.m.).

*****Please contact the Poway Building Division if you have any questions or concerns at (858) 668-4645 or building@poway.org*****